




**RECOMMENDED LOCATION OF RAMPS**

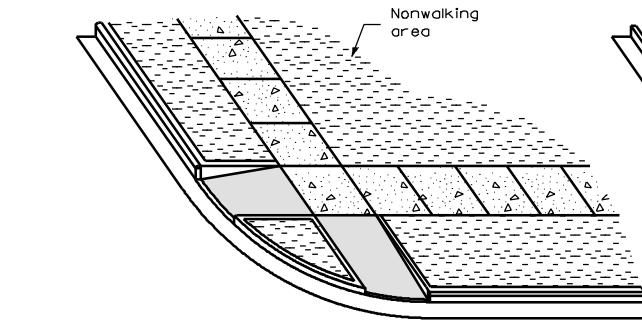

**TYPE A RAMPS**

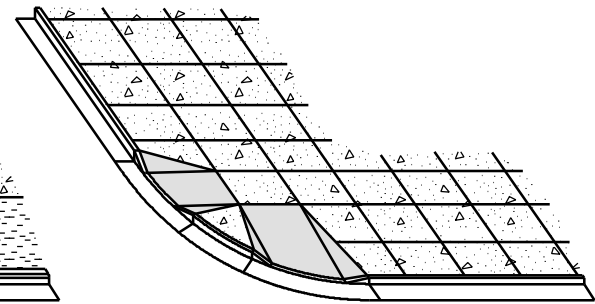


**TYPE B RAMPS**

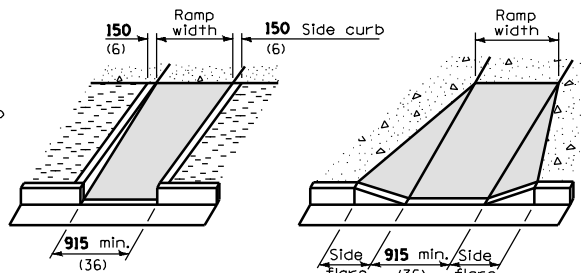

**TYPE A**


**TYPE B**

**DETAILS OF RAMPS**

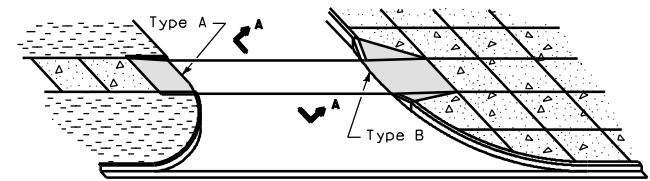


**RAMPS AT ALLEY OR DRIVEWAY**


**SECTION A-A**




**RAMP TEXTURE DETAIL**  
(\* Nominal dimensions)

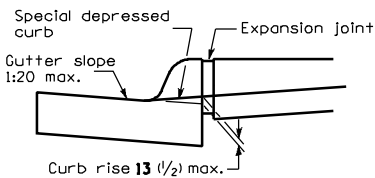


**DETAIL A**

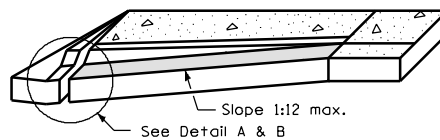

**RAMP PROFILE**

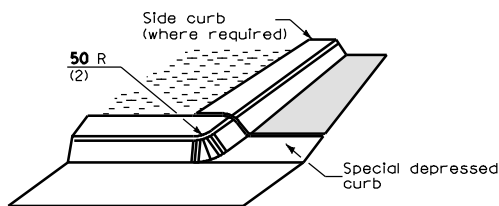

**DETAIL B**



**DETAIL OF SIDE CURB**  
(Side curb may be constructed monolithically with ramp)

**GENERAL NOTES**

Ramp texturing is to be done with an expanded metal grate placed and removed from wet concrete to leave a diamond pattern as shown. The long axis of the diamond pattern shall be perpendicular to the curb. Grooves shall be 3 mm (1/8") deep and 6 mm (1/4") wide.

The maximum slope of the side flare for Type B ramps shall be 1:10; however, if the width of the landing area between the top of the ramp and an obstruction is less than 1.2 m (4'-0") then the maximum slope shall be 1:12.

All slope ratios are expressed as units of vertical displacement to units of horizontal displacement (V:H).

All dimensions are in millimeters (inches) unless otherwise shown.

**LEGEND**

- Sidewalk
- Textured ramps surface
- Non walking area

DATE	REVISIONS
1-1-98	Added Section A-A.
	Added legend, stop bars, and width of median.
1-1-97	Renum. Standard 2356-2.

**CURB RAMPS  
ACCESSIBLE TO  
THE DISABLED**

**STANDARD 424001-01**